

CITY OF RIVERSIDE COUNCIL MEETING AGENDA
RIVERSIDE FIRE DEPARTMENT
271 E 1ST ST
REGULAR MEETING

Monday, January 18, 2021 – 6:00 P.M.

The meeting will be recorded and can be viewed live by visiting the city web site at www.riversideiowa.gov

NOTICE TO THE PUBLIC: This is a meeting of the City Council to conduct the regular business of the City. Every item on the agenda is an item of discussion and action if needed.

1. Call meeting to order
2. Approval of agenda
3. Consent agenda
 - a. Minutes from 1-4-2021
 - b. Expenditures for 1-18-2021
 - c. December Fire Department Report
4. **Public forum:** 3 minutes per person. See guidelines for public comments at the Clerk's table.
5. Award from Washington County Department of Public Health
6. MMS Consultants report
 - a. Safe Routes to School-final inspection and retainage
7. PeopleService Inc
8. Public Hearings, Resolutions, Ordinances
 - a. Resolution #011821-01 Appoint Planning & Zoning New Members
 - b. Resolution #011821-02 Set Max Levy Public Hearing
 - c. Resolution #011821-03 Transfers
9. City Administrator's report
 - a. Monthly Financial Report
10. Motion to adjourn

Budget Work Session

1. Estimated revenues, including water/sewer rates
2. Capital Projects

Meeting attendees are asked to maintain 6 ft. distance from other attendees who don't live in their household. Masks are required when distancing cannot be maintained. Those wishing to provide comments for the public forum without attending the meeting can submit them by email to admin@cityofriversideiowa.com, by phone at 319-648-3501, or in the City Hall dropbox up to 30 minutes prior to the meeting.

RIVERSIDE CITY COUNCIL MEETING: Monday, January 4th, 2010

The Riverside City Council meeting opened at 6:00 pm at the Fire Station with Mayor Pro Tem Tom Sexton requesting roll call. Council members present were: Andy Rodgers, Lois Schneider, Tom Sexton, McGuire, and Redlinger via phone. Mayor Schneider was absent.

Motion by Rodgers to approve agenda. Second by McGuire, passed 5-0.

Rodgers moved to approve the minutes of December 21st, 2020, and expenditures. Second by Schneider, passed 5-0.

Scott Pottorff, MMS Consultants reported that 4th Street is complete, and documents are being sent to Iowa DOT for Safe Route to School.

Council reviewed committee appointments for 2021.

McGuire moved to pass Resolution #010421-01, Appointing Committees for 2021. Second by Rodgers, passed 5-0.

Schneider moved to pass Resolution #010421-02, Appointing Tom Sexton as Mayor Pro Tem for 2021. Second by Rodgers, passed 5-0.

Rodgers moved to pass Resolution #010421-03, Appointing William Sueppel as City Attorney for 2021. Second by McGuire, passed 5-0.

McGuire moved to pass Resolution #010421-04, Approving Kalona Library contract for FY 22 in the amount of \$21,582.62. Second by Schneider, passed 5-0.

Council reviewed Admin's report.

Community Center Survey results will be presented at next week's budget work session.

Redlinger moved to adjourn at 6:24 pm. Second by Rodgers, passed 5-0


Full content of Council Meetings can be viewed on the City web site; riversideiowa.gov

Budget Work Session- Monday, January 11th, 2021 at 6:00 p.m. in Fire Station

Council Meeting – Monday, January 18th, 2021 at 6:00 p.m. in Fire Station.

ATTEST:


Becky LaRoche; City Clerk

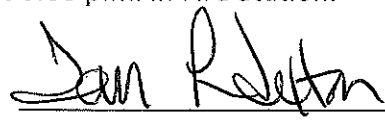 Jan 5, 2021
Tom Sexton; Mayor Pro Tem

| | | | | | |
|----|--------------------------------|------------------------------|-----------------|-----------------|-----------------|
| | EXPENDITURES 01-18-2021 | | | | |
| | COUNCIL MEETING | UNPAID BILLS: | | | |
| | | | | | |
| 1 | AIRGAS | RVFD | 002-5-150-6356 | \$ 100.72 | |
| 2 | CITY SEWER | SHOP | 001-5-210-6506 | \$ 109.50 | |
| 3 | DNR | NPDES 2021 | 610-5-815-6245 | \$ 85.00 | |
| 4 | HEIMAN | RVFD | 002-5-150-6356 | \$ 2,902.50 | |
| 5 | IOWA ONE CALL | LOCATES | 600-5-810-6507 | \$ 26.20 | |
| 6 | IOWA SOLUTIONS | RVFD | 002-5-150-6340 | \$ 1,403.75 | |
| 7 | IOWA SOLUTIONS | CITY HALL | 001-5-650-6497 | \$ 1,229.05 | \$ 2,632.80 |
| 8 | JOHNSON COUNTY REFUSE | SERVICE | 670-5-840-6499 | \$ 7,157.50 | |
| 9 | KALONA AUTO | RVFD | 002-5-150-6352 | \$ (31.73) | |
| 10 | KALONA AUTO | SHOP | 001-5-430-6325 | \$ 309.42 | \$ 277.69 |
| 11 | LEAF | COPIER LEASE | 001-5-650-6496 | \$ 156.50 | |
| 12 | MENARDS | SHOP | 001-5-210-6372 | \$ 27.73 | |
| 13 | MENARDS | RENTAL | 001-5-470-6310 | \$ 79.63 | \$ 107.36 |
| 14 | MIDWEST FRAME | SNOW PLOW | 110-5-210-6335 | \$ 151.91 | |
| 15 | OFFICE EXPRESS | SUPPLY | 001-5-650-6506 | \$ 286.55 | |
| 16 | PAWS & MORE | 4TH QTR | 001-5-190-6413 | \$ 176.00 | |
| 17 | REC | SIGN | 001-5-520-6510 | \$ 69.05 | |
| 18 | REC | LIFT STATION | 610-5-815-6371 | \$ 95.70 | |
| 19 | REC | W/W PLANT | 610-5-815-6371 | \$ 3,664.80 | |
| 20 | REC | SHOP | 001-5-210-6371 | \$ 39.42 | |
| 21 | REC | WATER PLANT | 600-5-810-6371 | \$ 3,323.90 | |
| 22 | REC | TRAFFIC LIGHT | 001-5-230-6371 | \$ 181.59 | |
| 23 | REC | CASINO L/S | 610-5-815-6371 | \$ 229.50 | \$ 7,603.96 |
| 24 | RIVERSIDE HISTORY CENTER | 4TH QTR GRANT | 145-5-650-6413 | \$ 5,148.87 | |
| 25 | SANDRY FIRE SUPPLY | RVFD | 002-5-150-6356 | \$ 844.00 | |
| 26 | SEI CITY CLERKS | 2021 | 001-5-650-6210 | \$ 20.00 | |
| 27 | STANDARD PEST CONTROL | SERVICE | 001-5-650-6310 | \$ 60.00 | |
| 28 | THE NEWS | PUBLICATIONS | 001-5-650-6402 | \$ 164.71 | |
| 29 | VISA | OFFICE | 001-5-650-6506 | \$ 163.00 | |
| 30 | VISA | USTREAM | 001-5-650-6494 | \$ 99.00 | \$ 262.00 |
| 31 | WA. CO. AUDITOR | 1ST QTR LAW CONTRACT | 001-5-110-6499 | \$ 24,332.50 | |
| 32 | WILSON, LINDA | RB ROOM REFUND-COVID | 001-5-650-6510 | \$ 150.00 | |
| 33 | YANCEY, CHRISTINE | MILEAGE | 001-5-650-6240 | \$ 62.16 | |
| 34 | ***** | TOTAL BILLS | | \$ 52,818.43 | |
| 35 | | PAID BILLS: | | | |
| 36 | IOWA DEPT OF REVENUE | IOWA WITHHOLDINGS - 2020 DEC | \$ 698.00 | | |
| 37 | IOWA DEPT OF REVENUE | IOWA SALES TAX - 2020 DEC | \$ 820.00 | | |
| 38 | IOWA DEPT OF REVENUE | IOWA WET TAX - 2020 DEC | \$ 1,526.00 | | |
| 39 | IPERS | CONTRIBUTIONS - 2020 DEC | \$ 2,707.95 | | |
| 40 | IRS | 941 TAX DEPOSIT - 2020 DEC | \$ 3,706.07 | | |
| 41 | PAYROLL | PAYROLL - 2020 DEC | \$ 13,146.83 | | |
| 42 | 1ST NAT'L BANK | JAN 21 "HSA" | \$ 750.00 | | |
| 43 | | TOTAL PAID BILLS | | \$ 23,354.85 | |
| 44 | ***** | TOTAL EXPENDITURES | | \$ 76,173.28 | |
| 45 | GENERAL FUND | | \$ 27,715.81 | | |
| 46 | FIRE DEPARTMENT | | \$ 5,219.24 | | |
| 47 | ROAD USE FUND | | \$ 151.91 | | |
| 48 | CASINO FUNDS | | \$ 5,148.87 | | |
| 49 | DEBT SERVICE | | \$ - | | |
| 50 | CAPITAL PROJECTS | | \$ - | | |
| 51 | WATER FUND | | \$ 3,350.10 | | |
| 52 | SEWER FUND | | \$ 4,075.00 | | |
| 53 | GARBAGE | | \$ 7,157.50 | | |
| 54 | TOTAL EXPENDITURES | | \$ 52,818.43 | | |
| 55 | MTD TREASURERS REPORT | 9/30/2020 | REVENUES | EXPENSES | BALANCE |
| 56 | GENERAL FUND | | \$ 49,324.07 | \$ 36,811.65 | \$ 581,470.98 |
| 57 | FIRE DEPT FUND | | \$ 41,601.36 | \$ 11,365.05 | \$ 173,750.94 |
| 58 | ROAD USE TAX FUND | | \$ 12,178.05 | \$ 3,973.35 | \$ 166,827.71 |
| 59 | LOCAL OPTION SALES TAX | | \$ 10,398.96 | \$ - | \$ 199,866.70 |
| 60 | CASINO REVENUE RUND | | \$ 56,249.79 | \$ 11,974.19 | \$ 182,661.89 |
| 61 | DEBT SERVICE | | \$ - | \$ 250.00 | \$ (4,600.00) |
| 62 | CAPITAL PROJECTS FUND | | \$ 17,400.00 | \$ 183,421.25 | \$ (68,078.46) |
| 63 | COMMUNITY CENTER FUNDS | | \$ 106.56 | \$ - | \$ 1,019,904.51 |
| 64 | WATER FUND | | \$ 28,598.95 | \$ 20,183.12 | \$ 494,519.71 |
| 65 | SEWER FUND | | \$ 26,802.02 | \$ 17,418.81 | \$ 303,877.64 |
| 66 | GARBAGE/LANDFILL FUND | | \$ 7,123.34 | \$ 7,222.25 | \$ 9,711.77 |
| 67 | STORM WATER FUND | | \$ 1,594.38 | \$ - | \$ 14,088.73 |
| 68 | TOTAL | | \$ 251,377.48 | \$ 292,619.67 | \$ 3,074,002.12 |

RIVERSIDE FIRE DEPARTMENT

FIRE / RESCUE / EMS / HAZMAT



December 2020 Update

Calls for Service:

- Medicals - 15
- Structure Fires – 4
- Motor Vehicle Accidents – 2
- Sprinkler System Issue – 1

Total calls – 22 calls for service in December

RFD responded to a mix of calls for the month, the call volume continues to be steady and increasing. **RFD responded to 231 incidents for 2020**, that was up from 2019 (216). We also had slow months in March and April due to the start of COVID. If those would have been normal month's we would have probably finished 2020 around 250-260 calls.

Training:

The members trained on ice rescue and cold water emergencies. This included the members getting into the water with our ice rescue suits and performing Go Rescues on other members.

RESA:

The members completed the RFD community shirt sales fundraiser, that brought in \$900. The members also sold all 100 calendars to raise another \$2000 for RESA. The members have done an excellent job of getting creative with fundraisers this year, raising around \$11,000 for RESA to help with yearly operating costs/projects.

Other News

The progress on the new truck continues, the slideout is being built, the topper gets installed in January. The truck will be in service late February. The Chief is getting things ready for budget planning. We are currently looking for new members, we had 6 members retire over 2020. The longest serving member of RFD Bill Halleran retired with 45 years of dedication and service to the community. This will be a huge loss to RFD as Bill served as FF/EMT and over his years was the Fire Chief and Training Officer. RFD will start 2021 with 31 members of those members 8 have State of Iowa EMS certification.

"WE'RE STILL HERE AND READY TO RESPOND"

Thanks

Chief Smothers



Date: January 12, 2021

To: Riverside Council

From: Bill Stuke, Operator

O & M Report: December 2020

Water Operation & Maintenance

- All first stage membranes were installed with the assistance of Rhino Industries. PeopleService Assistant Region Manager Heath Dreager and Region Manager Steve Robbinette also assisted with installation. Some of the membranes on the first stage were heavily fouled with iron deposits and were likely the cause of increased pump demands. Consolidated Water offered to collect the old membranes to recondition for other uses. They have offered in exchange to trade us for some cleaning chemicals. This has saved several hundred dollars in landfill fees for disposal of the old membranes.
- Christine and I met with Brett DeWolfe to further discuss a sewer meter and City water rates.
- 15 locates and 1 emergency locate all complete.
- 7 door postings and 2 disconnects.
- Ben and I helped Bryan and Jay plow and haul snow over a few days during the snowstorms.

Wastewater Operation & Maintenance

- On 12-5-2020 while doing rounds I noticed the flow readings were abnormal at the wastewater plant. I went to check lift station 1 to see if there was an issue and I found the pump was continuously running. The cause was from a float being stuck and not allowing the pump to cycle off. The result was the pump air locking and not being able to prime itself. I called Electric Pump and they came to lift the pump up to release the air. We also adjusted the float to prevent it from getting stuck in the future. We don't have the capabilities to lift the pump ourselves.






- Rhino Industries completed cleaning out lagoon 1 in just a few days. This will be an annual event to remove the lime sludge from Engie, but the future solids content will be less and will take less time.
- On 12-24-2020 lift station 2 called at 10 PM for a low temp alarm. I placed the VFD's in bypass and ran the pumps on direct drive until the following Monday when temperatures warmed up.
- On 12-25-2020 I was called for a low level alarm at lift station 5. I found the transducer was not reading. I cleaned the transducer, but it is still not functioning. The station is running on back up floats until a new transducer arrives.


Iowa Department of Natural Resources


➤

BOD Effluent

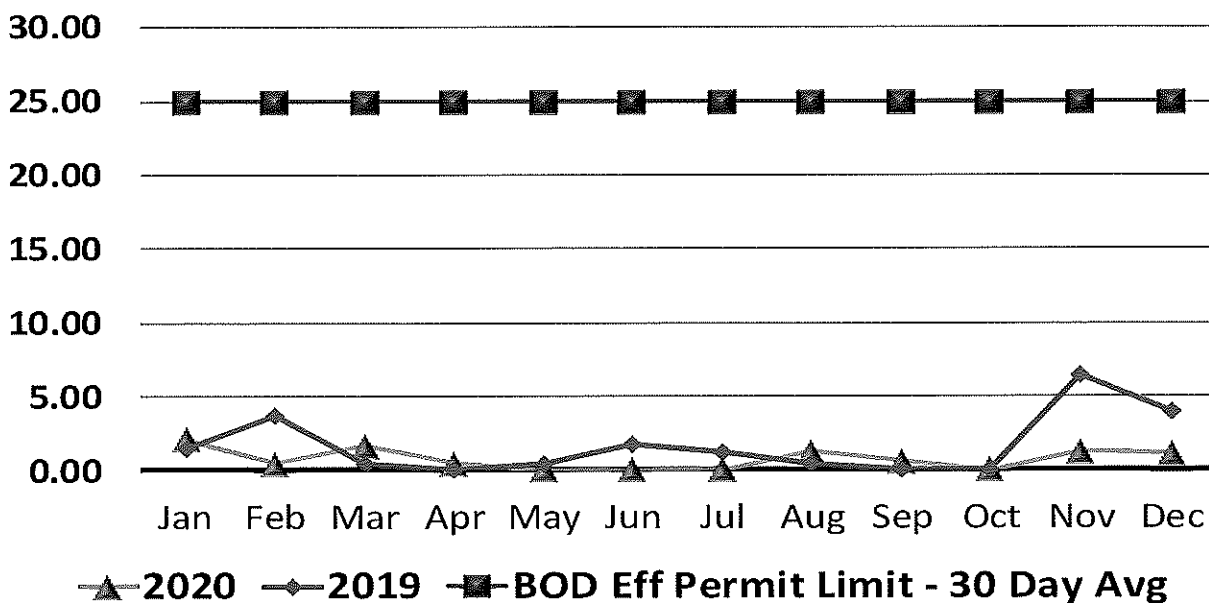

BOD % Removal

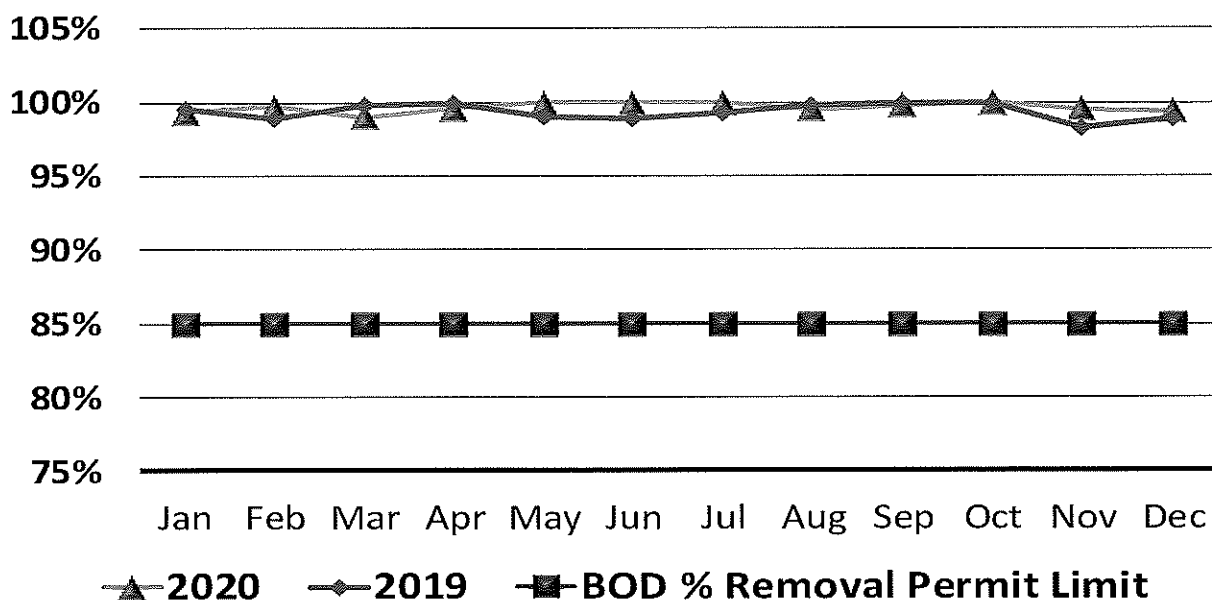

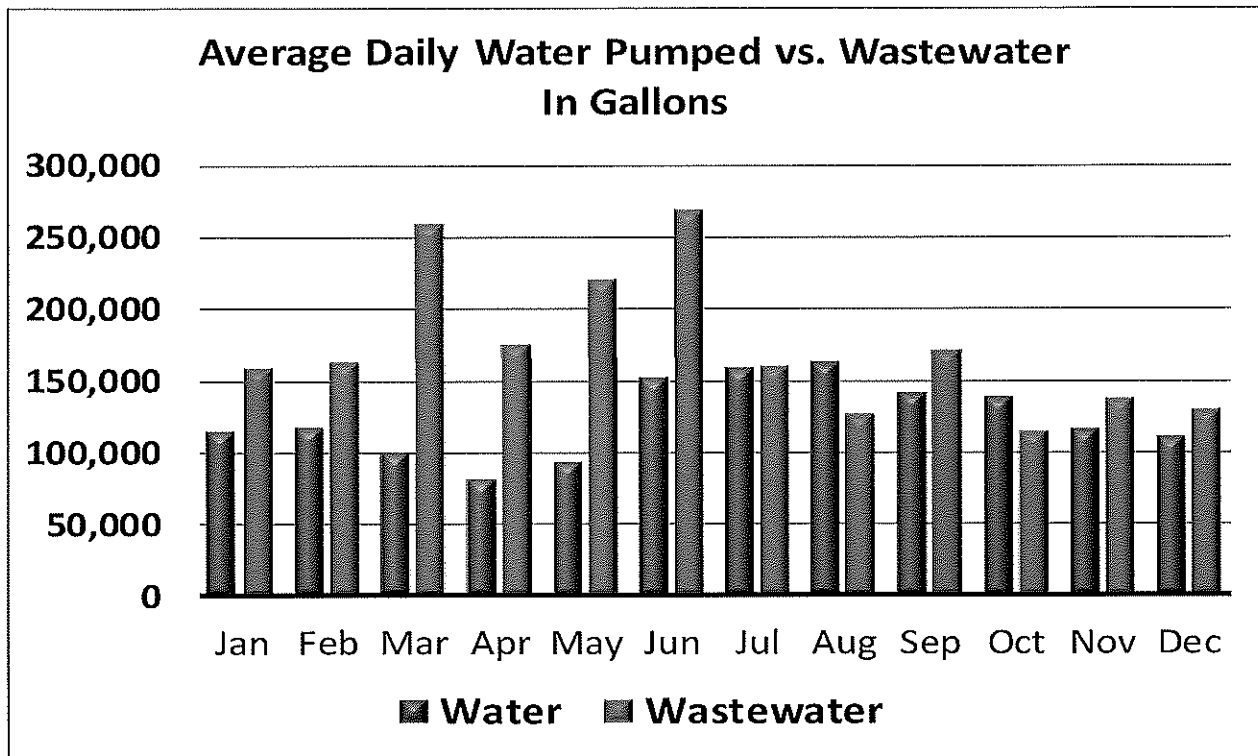

| Contract True-Ups - Current Contract Year | | | | |
|---|-----------------|--------------|-------------|-----------|
| Item | Budgeted Amount | Amount Spent | % of Budget | % of Time |
| Chemical Budget | \$26,209.00 | \$5,018.38 | 19% | 50% |
| Maintenance Budget | \$21,840.00 | \$4,696.49 | 22% | 50% |
| Total | \$48,049.00 | \$9,714.87 | 20% | 50% |

PeopleService INC.

Water & Wastewater Professionals

| | | December-20 | November-20 | December-19 |
|--|--------------|-------------|-------------|-------------|
| Water | Units | | | |
| Total Monthly Pumped | gallons | 3,426,000 | 3,511,000 | 3,500,000 |
| Average Daily Pumped | gallons | 110,520 | 117,030 | 112,900 |
| Maximum Daily Pumped | gallons | 266,000 | 213,000 | 236,000 |
| Minimum Daily Pumped | gallons | 0 | 9 | 15,000 |
| Chlorine | | | | |
| Chlorine - Total Avg Residual Plant | mg/L | 1.73 | 1.98 | 1.04 |
| Chlorine - Total Avg Residual System | mg/L | 1.02 | 1.10 | 1.09 |
| Chlorine - Recommended Residual System | mg/L | 0.30 | 0.30 | 0.30 |
| Chlorine used | lbs | 127.00 | 114.00 | 129.00 |
| Iron | | | | |
| Iron - Avg Raw | mg/L | 2.00 | 1.93 | 1.93 |
| Polyphosphate | | | | |
| Polyphosphate - Avg Residual | mg/L | 1.72 | 1.56 | 1.34 |
| Polyphosphate - Recommended Residual | mg/L | 0.5 - 2.0 | 0.5 - 2.0 | 0.5 - 2.0 |
| Polyphosphate used | lbs | 25.00 | 21.50 | 18.00 |
| Water Loss | | | | |
| Water Billed | gallons | 2,390,051 | 2,902,373 | 2,878,579 |
| Water used in main breaks/hydrant flushing | gallons | 0 | 30,000 | 10,000 |
| Water used at city buildings | gallons | 127,000 | 94,000 | 72,817 |
| Loss | gallons | 27% | 2% | 15% |
| Wastewater | | | | |
| BOD | | | | |
| BOD Influent Avg | mg/L | 192 | 262 | 371 |
| BOD Effluent Avg | mg/L | 1 | 1.3 | 4 |
| BOD Eff Permit Limit - 30 Day Avg | mg/L | 25 | 25 | 25 |
| BOD % Removal | % | 99.41% | 99.52% | 98.90% |
| BOD % Removal Permit Limit | % | 85% | 85% | 85% |
| TSS | | | | |
| TSS Influent Avg | mg/L | 192 | 215 | 226 |
| TSS Effluent Avg | mg/L | 5 | 20 | 4 |
| TSS Effluent Permit Limit - 30 Day Avg | mg/L | 30 | 30 | 30 |
| TSS % Removal | % | 97.50% | 90.70% | 98.10% |
| TSS % Removal Permit Limit | % | 85% | 85% | 85% |
| Nitrogen Ammonia | | | | |
| NA Effluent Avg | mg/L | 0 | 0 | 3 |
| NA Effluent Permit Limit - 30 Day Avg | mg/L | 10 | 8 | 10 |
| Influent Flow | | | | |
| Total Monthly | gallons | 4,013,600 | 4,114,900 | 4,145,400 |
| Average Daily | gallons | 129,470 | 138,163 | 133,722 |
| Maximum Daily | gallons | 301,600 | 438,200 | 353,700 |
| Minimum Daily | gallons | 86,600 | 82,900 | 94,100 |
| Permit Limit - 30 Day Avg | gallons | 444,000 | 444,000 | 444,000 |
| Permit Limit - Daily Maximum | gallons | 1,425,000 | 1,425,000 | 1,425,000 |

PeopleService INC.
Water & Wastewater Professionals
RIVERSIDE--DECEMBER '20

Water Plant Maintenance

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|---------------------------|--------------------|-----------------|
| 12/8/20 | Hydrotex | Ultra Kleen | \$194.66 |
| 12/26/20 | First National Bank, VISA | Supplies | \$46.83 |
| | | Total | \$241.49 |

Water System Maintenance

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|---------------------------|--------------------|----------------|
| 12/26/20 | First National Bank, VISA | Supplies | \$31.17 |
| | | Total | \$31.17 |

Wastewater Plant Maintenance

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|---------------------------|--------------------|----------------|
| 12/26/20 | First National Bank, VISA | Supplies | \$63.12 |
| | | Total | \$63.12 |

Wastewater System Maintenance

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|---------------------------|--------------------|----------------|
| 12/26/20 | First National Bank, VISA | Supplies | \$31.17 |
| | | Total | \$31.17 |

| | |
|--------------------------|-----------------|
| Water Plant Maintenance | \$241.49 |
| Water System Maintenance | \$31.17 |
| W/W Plant Maintenance | \$63.12 |
| W/W System Maintenance | \$31.17 |
| Month Total | <u>\$366.95</u> |

| | |
|----------------------------------|--------------------|
| Annual Maintenance Budget | \$21,840.00 |
|----------------------------------|--------------------|

| | |
|---|-------------------|
| Total Maintenance Dollars Spent Year to Date | \$4,696.49 |
|---|-------------------|

| | |
|--|------------|
| Percent Maintenance Budget Spent Year to Date | 22% |
|--|------------|

PeopleService INC.
Water & Wastewater Professionals
RIVERSIDE - DECEMBER '20

Water System Chemicals

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|--------------------|---------------------|-----------------|
| 12/3/20 | Hawkins | Sodium Hypochlorite | \$225.00 |
| 12/3/20 | Hawkins | Caustic | \$395.00 |
| | | Total | \$620.00 |

Wastewater System Chemicals

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|--------------------|--------------------|---------------|
| | | Total | \$0.00 |

| | |
|------------------------|-----------------|
| Water System Chemicals | \$620.00 |
| W/W System Chemicals | \$0.00 |
| Month Total | \$620.00 |

Annual Chemical Budget **\$26,209.00**

**Total Chemical Dollars
Spent Year to Date** **\$5,018.38**

**Percent Chemical Budget
Spent Year to Date** **19%**

| | |
|-------------------------|-----------------|
| Maintenance Month Total | \$366.95 |
| Chemical Month Total | \$620.00 |
| Month Total | \$986.95 |

Annual Budget **\$48,049.00**

Total Spent Year to Date **\$9,714.87**

**Percent Budget Spent
Year to Date** **20%**



Work Orders Completed

| Date completed | Equipment | Task |
|----------------|-----------------------|-------------------|
| 12/7/2020 | BLOWERS | Monthly PM |
| 12/7/2020 | BLOWER #1 | Service Equipment |
| 12/7/2020 | BLOWER #2 | Service Equipment |
| 12/7/2020 | BLOWER #3 | Service Equipment |
| 12/7/2020 | WWTP GENERATOR | Monthly PM |
| 12/16/2020 | LIFT STATION #1 | LS Monthly PM |
| 12/3/2020 | LIFT STATION #1 | LS Quarterly PM |
| 12/3/2020 | LIFT STATION #2 | LS Monthly PM |
| 12/16/2020 | LIFT STATION #2 | LS Quarterly PM |
| 12/3/2020 | LIFT STATION #3 | LS Monthly PM |
| 12/16/2020 | LIFT STATION #3 | LS Quarterly PM |
| 12/16/2020 | LIFT STATION #4 | LS Monthly PM |
| 12/3/2020 | LIFT STATION #4 | LS Quarterly PM |
| 12/3/2020 | LIFT STATION #5 | LS Monthly PM |
| 12/16/2020 | LIFT STATION #5 | LS Quarterly PM |
| 12/7/2020 | MAIN LIFT STATION | LS Monthly PM |
| 12/3/2020 | EFFLUENT SAMPLER | Monthly PM |
| 12/3/2020 | INFLUENT SAMPLER | Monthly PM |
| 12/7/2020 | SCREEN UNIT | Monthly PM |
| 12/3/2020 | UV SYSTEM | Monthly PM |
| 12/3/2020 | FIRE EXTINGUISHERS | Inspection |
| 12/29/2020 | FILTER | Monthly PM |
| 12/29/2020 | CARTRIDGE FILTERS | Monthly PM |
| 12/1/2020 | DEHUMIDIFIERS | Monthly PM |
| 12/7/2020 | WATER PLANT GENERATOR | Monthly PM |
| 12/3/2020 | HIGH SERVICE PUMPS | Monthly PM |
| 12/7/2020 | WATER PLANT HEATER | Inspection |
| 12/7/2020 | INTERSTAGE PUMP #1 | Annual PM |
| 12/7/2020 | INTERSTAGE PUMP #2 | Annual PM |
| 12/7/2020 | INTERSTAGE PUMP #3 | Annual PM |
| 12/1/2020 | FIRE EXTINGUISHERS | Inspection |



Date: January 12, 2021

To: Riverside Council

From: Bill Stuke, Operator

O & M Report: December 2020

Water Operation & Maintenance

- All first stage membranes were installed with the assistance of Rhino Industries. PeopleService Assistant Region Manager Heath Dreager and Region Manager Steve Robbinette also assisted with installation. Some of the membranes on the first stage were heavily fouled with iron deposits and were likely the cause of increased pump demands. Consolidated Water offered to collect the old membranes to recondition for other uses. They have offered in exchange to trade us for some cleaning chemicals. This has saved several hundred dollars in landfill fees for disposal of the old membranes.
- Christine and I met with Brett DeWolfe to further discuss a sewer meter and City water rates.
- 15 locates and 1 emergency locate all complete.
- 7 door postings and 2 disconnects.
- Ben and I helped Bryan and Jay plow and haul snow over a few days during the snowstorms.

Wastewater Operation & Maintenance

- On 12-5-2020 while doing rounds I noticed the flow readings were abnormal at the wastewater plant. I went to check lift station 1 to see if there was an issue and I found the pump was continuously running. The cause was from a float being stuck and not allowing the pump to cycle off. The result was the pump air locking and not being able to prime itself. I called Electric Pump and they came to lift the pump up to release the air. We also adjusted the float to prevent it from getting stuck in the future. We don't have the capabilities to lift the pump ourselves.




- Rhino Industries completed cleaning out lagoon 1 in just a few days. This will be an annual event to remove the lime sludge from Engie, but the future solids content will be less and will take less time.
- On 12-24-2020 lift station 2 called at 10 PM for a low temp alarm. I placed the VFD's in bypass and ran the pumps on direct drive until the following Monday when temperatures warmed up.
- On 12-25-2020 I was called for a low level alarm at lift station 5. I found the transducer was not reading. I cleaned the transducer, but it is still not functioning. The station is running on back up floats until a new transducer arrives.


Iowa Department of Natural Resources

➤


BOD Effluent

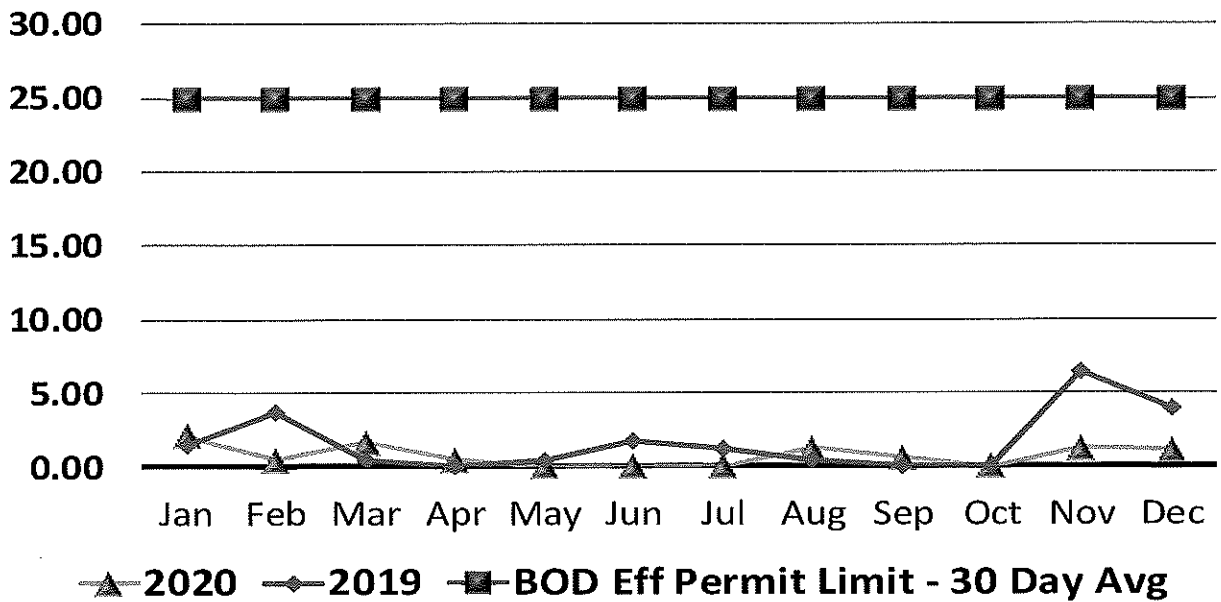

BOD % Removal

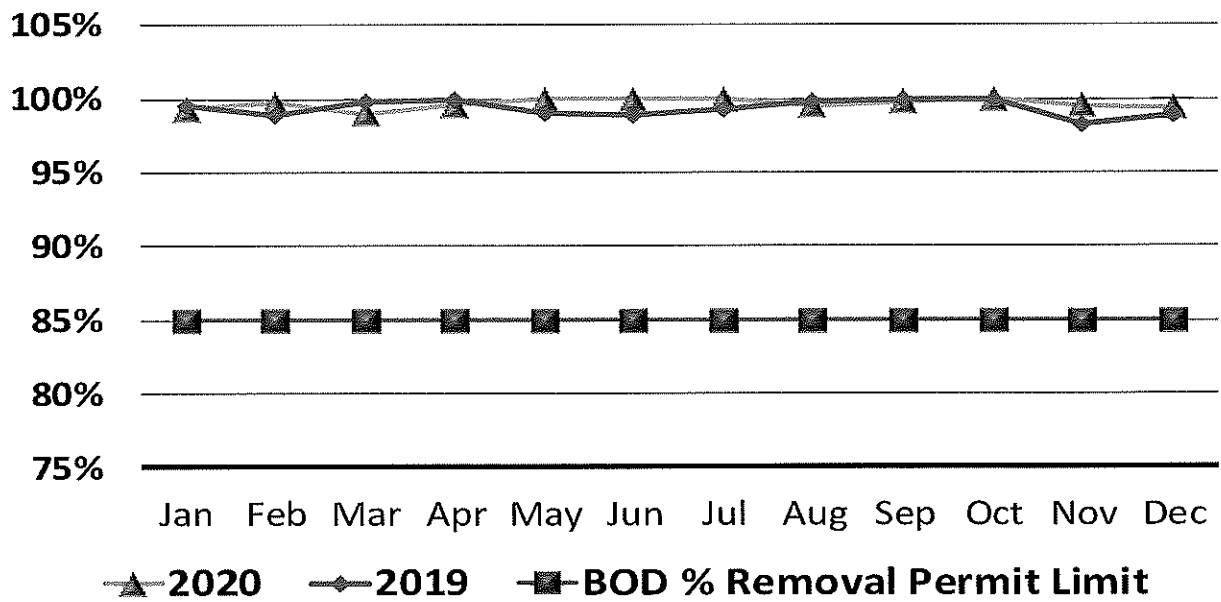

Average Daily Water Pumped vs. Wastewater In Gallons

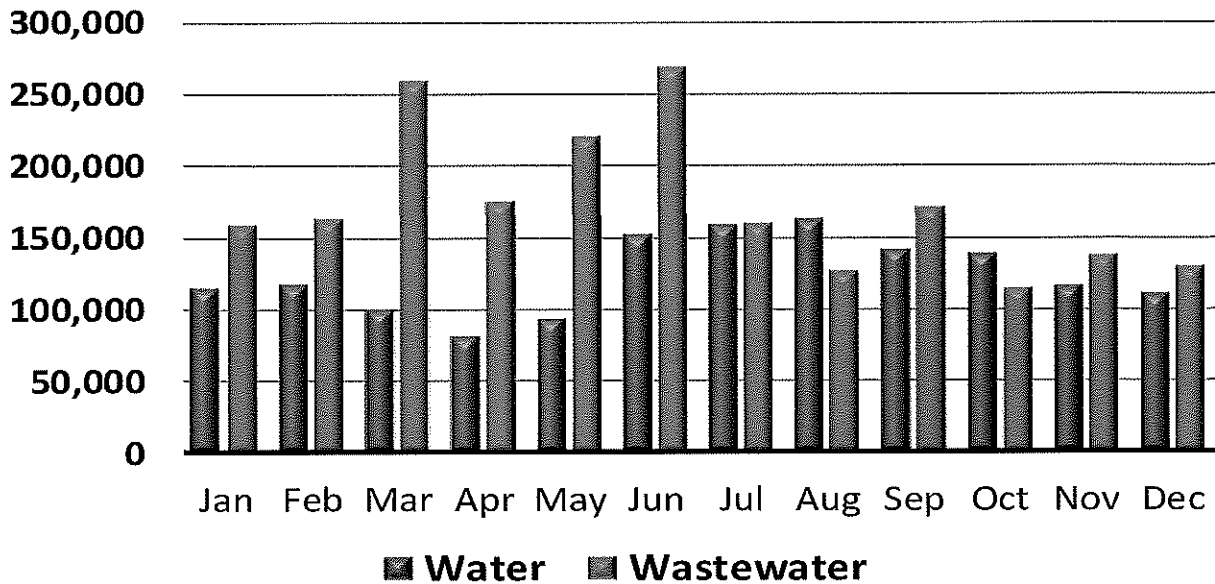

| Contract True-Ups - Current Contract Year | | | | |
|---|-----------------|--------------|-------------|-----------|
| Item | Budgeted Amount | Amount Spent | % of Budget | % of Time |
| Chemical Budget | \$26,209.00 | \$5,018.38 | 19% | 50% |
| Maintenance Budget | \$21,840.00 | \$4,696.49 | 22% | 50% |
| Total | \$48,049.00 | \$9,714.87 | 20% | 50% |

PeopleService INC.

Water & Wastewater Professionals

| | | December-20 | November-20 | December-19 |
|--|--------------|-------------|-------------|-------------|
| Water | Units | | | |
| Total Monthly Pumped | gallons | 3,426,000 | 3,511,000 | 3,500,000 |
| Average Daily Pumped | gallons | 110,520 | 117,030 | 112,900 |
| Maximum Daily Pumped | gallons | 266,000 | 213,000 | 236,000 |
| Minimum Daily Pumped | gallons | 0 | 9 | 15,000 |
| Chlorine | | | | |
| Chlorine - Total Avg Residual Plant | mg/L | 1.73 | 1.98 | 1.04 |
| Chlorine - Total Avg Residual System | mg/L | 1.02 | 1.10 | 1.09 |
| Chlorine - Recommended Residual System | mg/L | 0.30 | 0.30 | 0.30 |
| Chlorine used | lbs | 127.00 | 114.00 | 129.00 |
| Iron | | | | |
| Iron - Avg Raw | mg/L | 2.00 | 1.93 | 1.93 |
| Polyphosphate | | | | |
| Polyphosphate - Avg Residual | mg/L | 1.72 | 1.56 | 1.34 |
| Polyphosphate - Recommended Residual | mg/L | 0.5 - 2.0 | 0.5 - 2.0 | 0.5 - 2.0 |
| Polyphosphate used | lbs | 25.00 | 21.50 | 18.00 |
| Water Loss | | | | |
| Water Billed | gallons | 2,390,051 | 2,902,373 | 2,878,579 |
| Water used in main breaks/hydrant flushing | gallons | 0 | 30,000 | 10,000 |
| Water used at city buildings | gallons | 127,000 | 94,000 | 72,817 |
| Loss | gallons | 27% | 2% | 15% |
| Wastewater | | | | |
| BOD | | | | |
| BOD Influent Avg | mg/L | 192 | 262 | 371 |
| BOD Effluent Avg | mg/L | 1 | 1.3 | 4 |
| BOD Eff Permit Limit - 30 Day Avg | mg/L | 25 | 25 | 25 |
| BOD % Removal | % | 99.41% | 99.52% | 98.90% |
| BOD % Removal Permit Limit | % | 85% | 85% | 85% |
| TSS | | | | |
| TSS Influent Avg | mg/L | 192 | 215 | 226 |
| TSS Effluent Avg | mg/L | 5 | 20 | 4 |
| TSS Effluent Permit Limit - 30 Day Avg | mg/L | 30 | 30 | 30 |
| TSS % Removal | % | 97.50% | 90.70% | 98.10% |
| TSS % Removal Permit Limit | % | 85% | 85% | 85% |
| Nitrogen Ammonia | | | | |
| NA Effluent Avg | mg/L | 0 | 0 | 3 |
| NA Effluent Permit Limit - 30 Day Avg | mg/L | 10 | 8 | 10 |
| Influent Flow | | | | |
| Total Monthly | gallons | 4,013,600 | 4,114,900 | 4,145,400 |
| Average Daily | gallons | 129,470 | 138,163 | 133,722 |
| Maximum Daily | gallons | 301,600 | 438,200 | 353,700 |
| Minimum Daily | gallons | 86,600 | 82,900 | 94,100 |
| Permit Limit - 30 Day Avg | gallons | 444,000 | 444,000 | 444,000 |
| Permit Limit - Daily Maximum | gallons | 1,425,000 | 1,425,000 | 1,425,000 |

PeopleService INC.
Water & Wastewater Professionals
RIVERSIDE--DECEMBER '20

Water Plant Maintenance

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|---------------------------|--------------------|-----------------|
| 12/8/20 | Hydrotex | Ultra Kleen | \$194.66 |
| 12/26/20 | First National Bank, VISA | Supplies | \$46.83 |
| | | Total | \$241.49 |

Water System Maintenance

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|---------------------------|--------------------|----------------|
| 12/26/20 | First National Bank, VISA | Supplies | \$31.17 |
| | | Total | \$31.17 |

Wastewater Plant Maintenance

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|---------------------------|--------------------|----------------|
| 12/26/20 | First National Bank, VISA | Supplies | \$63.12 |
| | | Total | \$63.12 |

Wastewater System Maintenance

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|---------------------------|--------------------|----------------|
| 12/26/20 | First National Bank, VISA | Supplies | \$31.17 |
| | | Total | \$31.17 |

| | |
|--------------------------|-----------------|
| Water Plant Maintenance | \$241.49 |
| Water System Maintenance | \$31.17 |
| WW Plant Maintenance | \$63.12 |
| WW System Maintenance | \$31.17 |
| Month Total | <u>\$366.95</u> |

Annual Maintenance Budget \$21,840.00

Total Maintenance Dollars Spent Year to Date \$4,696.49

Percent Maintenance Budget Spent Year to Date 22%

PeopleService INC.
Water & Wastewater Professionals
RIVERSIDE - DECEMBER '20

Water System Chemicals

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|--------------------|---------------------|-----------------|
| 12/3/20 | Hawkins | Sodium Hypochlorite | \$225.00 |
| 12/3/20 | Hawkins | Caustic | \$395.00 |
| | | Total | \$620.00 |

Wastewater System Chemicals

| <u>Date</u> | <u>Vendor List</u> | <u>Description</u> | <u>Total</u> |
|-------------|--------------------|--------------------|---------------|
| | | Total | \$0.00 |

| | |
|------------------------|----------|
| Water System Chemicals | \$620.00 |
| W/W System Chemicals | \$0.00 |
| Month Total | \$620.00 |

| | |
|-------------------------------|--------------------|
| Annual Chemical Budget | \$26,209.00 |
|-------------------------------|--------------------|

| | |
|--|-------------------|
| Total Chemical Dollars Spent Year to Date | \$5,018.38 |
|--|-------------------|

| | |
|---|------------|
| Percent Chemical Budget Spent Year to Date | 19% |
|---|------------|

| | |
|-------------------------|-----------------|
| Maintenance Month Total | \$366.95 |
| Chemical Month Total | \$620.00 |
| Month Total | \$986.95 |

| | |
|----------------------|--------------------|
| Annual Budget | \$48,049.00 |
|----------------------|--------------------|

| | |
|---------------------------------|-------------------|
| Total Spent Year to Date | \$9,714.87 |
|---------------------------------|-------------------|

| | |
|--|------------|
| Percent Budget Spent Year to Date | 20% |
|--|------------|



Work Orders Completed

| Date completed | Equipment | Task |
|----------------|-----------------------|-------------------|
| 12/7/2020 | BLOWERS | Monthly PM |
| 12/7/2020 | BLOWER #1 | Service Equipment |
| 12/7/2020 | BLOWER #2 | Service Equipment |
| 12/7/2020 | BLOWER #3 | Service Equipment |
| 12/7/2020 | WWTP GENERATOR | Monthly PM |
| 12/16/2020 | LIFT STATION #1 | LS Monthly PM |
| 12/3/2020 | LIFT STATION #1 | LS Quarterly PM |
| 12/3/2020 | LIFT STATION #2 | LS Monthly PM |
| 12/16/2020 | LIFT STATION #2 | LS Quarterly PM |
| 12/3/2020 | LIFT STATION #3 | LS Monthly PM |
| 12/16/2020 | LIFT STATION #3 | LS Quarterly PM |
| 12/16/2020 | LIFT STATION #4 | LS Monthly PM |
| 12/3/2020 | LIFT STATION #4 | LS Quarterly PM |
| 12/3/2020 | LIFT STATION #5 | LS Monthly PM |
| 12/16/2020 | LIFT STATION #5 | LS Quarterly PM |
| 12/7/2020 | MAIN LIFT STATION | LS Monthly PM |
| 12/3/2020 | EFFLUENT SAMPLER | Monthly PM |
| 12/3/2020 | INFLUENT SAMPLER | Monthly PM |
| 12/7/2020 | SCREEN UNIT | Monthly PM |
| 12/3/2020 | UV SYSTEM | Monthly PM |
| 12/3/2020 | FIRE EXTINGUISHERS | Inspection |
| 12/29/2020 | FILTER | Monthly PM |
| 12/29/2020 | CARTRIDGE FILTERS | Monthly PM |
| 12/1/2020 | DEHUMIDIFIERS | Monthly PM |
| 12/7/2020 | WATER PLANT GENERATOR | Monthly PM |
| 12/3/2020 | HIGH SERVICE PUMPS | Monthly PM |
| 12/7/2020 | WATER PLANT HEATER | Inspection |
| 12/7/2020 | INTERSTAGE PUMP #1 | Annual PM |
| 12/7/2020 | INTERSTAGE PUMP #2 | Annual PM |
| 12/7/2020 | INTERSTAGE PUMP #3 | Annual PM |
| 12/1/2020 | FIRE EXTINGUISHERS | Inspection |

RESOLUTION #011821-01

RESOLUTION APPROVING PLANNING & ZONING APPOINTMENT

WHEREAS the City of Riverside has determined that it is necessary to appoint volunteers to serve on the Planning & Zoning Commission to complete the duties described in the City of Riverside Code of Ordinances.

NOW, THEREFORE, BE IT RESOLVED by the City of Riverside City Council of Riverside, IA to appoint Denise Reschly to the Planning & Zoning Commission, for a 5 year term, through December 31, 2025, and Doug Havel to fill a one year term vacated by John Sojka.

MOVED BY Councilperson , _____ **Seconded by** Councilperson , _____ to approved the foregoing resolution.

PASSED AND APPROVED this 18th day of January, 2021 by the City Council of Riverside, IA.

Roll Call: Sexton, Rodgers, Redlinger, McGuire, Schneider

Ayes:

Nays:

Absents:

Signed: _____ Date: _____

Allen Schneider, Mayor

Attest: _____ Date: _____

Becky LaRoche, City Clerk

RESOLUTION #011821-02

**RESOLUTION SETTING TIME AND PLACE FOR A PUBLIC HEARING FOR
THE PURPOSE OF CONSIDERING THE MAXIMUM TAX DOLLARS FROM
CERTAIN LEVIES FOR THE CITY'S PROPOSED FISCAL YEAR 2021-2022
BUDGET**

WHEREAS, the City Council of Riverside, Iowa is preparing the annual budget for the Fiscal Year 2021-2022; and

WHEREAS, Iowa SF 634 requires a public hearing on the proposed maximum property tax dollars from certain levies where any resident or taxpayer of the City may present to the City Council objections or arguments in favor of the tax dollars before the budget is adopted and certified to the county auditor; and

WHEREAS, interested residents or taxpayers having comments for or against the maximum property tax dollar proposal from certain levies may appear and be heard at the public hearing at the city council meeting on February 1, 2020, at 6:00 PM at the Riverside Fire Station, at 271 E 1st Street, Riverside, Iowa.

NOW, THEREFORE, BE IT RESOLVED, by the City Council of the City of Riverside, Iowa, that this confirms that the city council order the publication of a notice of public hearing pertaining to proposed maximum property tax dollars from certain levies not less than ten (10) days nor more than twenty (20) days prior to the date set for the hearing. A notice shall also be posted on the city website.

BE IT FURTHER RESOLVED, by the Riverside City Council of the City of Riverside, Iowa, that the Mayor and City Clerk are hereby authorized and directed to execute said resolution.

It was moved by Councilperson _____seconded by Councilperson _____, to adopt the foregoing resolution.

Roll call: Redlinger, Sexton, Rodgers, McGuire, Schneider

Ayes:

Nays:

Absent:

Signed: _____ Date: _____
Allen Schneider, Mayor

Attest: _____ Date: _____
Becky LaRoche, City Clerk

**NOTICE OF PUBLIC HEARING
RIVERSIDE CITY COUNCIL
RIVERSIDE, IOWA**

The City Council of the City of Riverside, Iowa will hold a public hearing for the purpose of considering the maximum tax dollars from certain levies for the City of Riverside's proposed fiscal year budget 2021-2022

The Public Hearing will be held on Monday, February 1st, at the regular Council Meeting which begins at 6:00 p.m., at Fire Station.

All interested persons are invited to attend the public hearing and to offer comments, orally or in writing, in support of or in opposition of the Budget Maximum Tax Dollars Levied. Written comments may be submitted to City Admin, P.O. Box 188, Riverside, IA 52327-0188, in advance of the public hearing. Any questions regarding the proposed City Budget Maximum Tax Dollars may also be directed to City Hall. A Copy of the Proposed Budget Maximum Tax Dollar Levy is available for public review at the

City Clerk's office.

Published upon the direction of the City Council of the City of Riverside, Iowa as provided by law.

Becky LaRoche, Riverside City Clerk

OK 1-21-21 News = 11 days

RESOLUTION #011821-03

**RESOLUTION APPROVING THE TRANSFER OF FUNDS FOR
THE 2020-2021 BUDGET YEAR**

WHEREAS, the City of Riverside exercises the right to transfer funds per the certified budget for Fiscal Year 2020-2021.

1. Transfer \$130,000 from the Road Use Fund to the Capital Project Fund, per the certified budget.
2. Transfer \$4,600 from the Casino Fund to the Debt Service Fund, per certified budget.

THEREFORE, be it hereby resolved, the City of Riverside City Council directs the City Clerk to transfer funds in the amount of \$134,600.00 as approved for the 2020/2021 budget year.

It was moved by Councilperson _____, seconded by Councilperson _____, that the foregoing Resolution be adopted.

Roll Call: Redlinger, Sexton, Rodgers, McGuire, Schneider

Ayes:

Nays:

Passed by the City of Riverside City Council and approved this 18th day of January, 2021.

Signed: _____ Date _____
Allen Schneider, Mayor

Attest: _____ Date _____
Becky LaRoche, City Clerk

CITY OF RIVERSIDE
MTD TREASURERS REPORT

AS OF: DECEMBER 31ST, 2020

| FUND | BEGINNING CASH BALANCE | M-T-D REVENUES | M-T-D EXPENSES | CASH BASIS BALANCE | NET CHANGE OTHER ASSETS | NET CHANGE LIABILITIES | ACCRUAL ENDING CASH BALANCE |
|----------------------------|---------------------------|-------------------|-------------------|-----------------------|----------------------------|---------------------------|--------------------------------|
| 001-GENERAL FUND | 568,197.10 | 49,324.07 | 36,811.65 | 580,709.52 | (1,042.24) | (280.78) | 581,470.98 |
| 002-FIRE DEPARTMENT | 143,514.63 | 41,601.36 | 11,365.05 | 173,750.94 | 0.00 | 0.00 | 173,750.94 |
| 110-ROAD USE TAX | 158,623.01 | 12,178.05 | 3,973.35 | 166,827.71 | 0.00 | 0.00 | 166,827.71 |
| 121-LOCAL OPTION SALES TAX | 189,467.74 | 10,398.96 | 0.00 | 199,866.70 | 0.00 | 0.00 | 199,866.70 |
| 125-TIF | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 | 0.00 |
| 145-CASINO REVENUE FUND | 138,386.29 | 56,249.79 | 11,974.19 | 182,661.89 | 0.00 | 0.00 | 182,661.89 |
| 200-DEBT SERVICE | (4,350.00) | 0.00 | 250.00 | (4,600.00) | 0.00 | (4,600.00 | (4,600.00 |
| 301-CAPITAL PROJECTS | 97,942.79 | 17,400.00 | 183,421.25 | (68,078.46) | 0.00 | (68,078.46 | (68,078.46 |
| 302-COMMUNITY CENTER FUNDS | 1,019,797.95 | 106.56 | 0.00 | 1,019,904.51 | 0.00 | 0.00 | 1,019,904.51 |
| 600-WATER FUND | 486,103.88 | 28,598.95 | 20,183.12 | 494,519.71 | 0.00 | 0.00 | 494,519.71 |
| 610-SEWER FUND | 294,494.43 | 26,808.63 | 17,418.81 | 303,884.25 | 0.00 | 0.00 | 303,884.25 |
| 670-LANDFILL/GARBAGE | 9,810.68 | 7,123.34 | 7,222.25 | 9,711.77 | 0.00 | 0.00 | 9,711.77 |
| 680-STORM WATER | 12,494.35 | 1,594.38 | 0.00 | 14,088.73 | 0.00 | 0.00 | 14,088.73 |
| GRAND TOTAL | 3,114,482.85 | 251,384.09 | 292,619.67 | 3,073,247.27 | (1,042.24) | (280.78) | 3,074,008.73 |

*** END OF REPORT ***

CITY OF RIVERSIDE
 POOLED CASH REPORT (FUND 999)
 AS OF: DECEMBER 31ST, 2020

| FUND | ACCOUNT# | ACCOUNT NAME | BEGINNING BALANCE | CURRENT ACTIVITY | CURRENT BALANCE |
|----------------------|----------|------------------------------|----------------------|---------------------|--------------------|
| <u>CLAIM ON CASH</u> | | | | | |
| 001-1110 | | CHECKING ACCT-GENERAL FUND | 568,197.10 | 13,273.88 | 581,470.98 |
| 002-1110 | | CHECKING ACCT-FIRE DEP. | 143,514.63 | 30,236.31 | 173,750.94 |
| 003-1110 | | CHECKING ACCT.-EMS DEPT. | 0.00 | 0.00 | 0.00 |
| 110-1110 | | CHECKING ACCT-ROAD USE TAX | 158,623.01 | 8,204.70 | 166,827.71 |
| 121-1110 | | CHECKING ACCT-LOST | 189,467.74 | 10,398.96 | 199,866.70 |
| 125-1110 | | CHECKING ACCT-TIF | 0.00 | 0.00 | 0.00 |
| 145-1110 | | CHECKING ACCT-CASINO REVENUE | 138,386.29 | 44,275.60 | 182,661.89 |
| 200-1110 | | CHECKING ACCT-DEBT SERVICE | (4,350.00) | (250.00) | (4,600.00) |
| 301-1110 | | CHECKING ACCT-CAP PROJECTS | 97,942.79 | (166,021.25) | (68,078.46) |
| 302-1110 | | COMMUNITY CENTER FUNDS | 1,019,797.95 | 106.56 | 1,019,904.51 |
| 600-1110 | | CHECKING ACCT-WATER | 486,103.88 | 8,415.83 | 494,519.71 |
| 610-1110 | | CHECKING ACCT-SEWER | 294,494.43 | 9,389.82 | 303,884.25 |
| 670-1110 | | CHECKING ACCT-GARBAGE | 9,810.68 | (98.91) | 9,711.77 |
| 680-1110 | | CHECKING ACCT-STORM WATER | <u>12,494.35</u> | <u>1,594.38</u> | <u>14,088.73</u> |
| TOTAL CLAIM ON CASH | | | 3,114,482.85 | (40,474.12) | 3,074,008.73 |

CASH IN BANK - POOLED CASH

| | | | | |
|-------------------------------------|------------------------------|-------------------|--------------|-------------------|
| 999-1110 | CASH IN BANK | 665,325.63 | (55,908.21) | 609,417.42 |
| 999-1112 | PEOPLES BANK MONEY MARKET | 1,125,855.37 | 239.05 | 1,126,094.42 |
| 999-1114 | HILLS BANK | 44,531.50 | 15,088.48 | 59,619.98 |
| 999-1115 | CB FUND | 501,849.61 | 106.56 | 501,956.17 |
| 999-1116 | COMMUNITY BUILDING CD #18936 | 0.00 | 0.00 | 0.00 |
| 999-1117 | COMMUNITY BUILDING CD#18975 | 292,742.74 | 0.00 | 292,742.74 |
| 999-1118 | WATER RESERVES CD#921190 | 258,972.40 | 0.00 | 258,972.40 |
| 999-1119 | COMMUNITY BUILDING CD#19068 | <u>225,205.60</u> | <u>0.00</u> | <u>225,205.60</u> |
| SUBTOTAL CASH IN BANK - POOLED CASH | | 3,114,482.85 | (40,474.12) | 3,074,008.73 |

WAGES PAYABLE

| | | | | |
|------------------------|---------------|-------------|-------------|-------------|
| 999-2010 | WAGES PAYABLE | <u>0.00</u> | <u>0.00</u> | <u>0.00</u> |
| SUBTOTAL WAGES PAYABLE | | <u>0.00</u> | <u>0.00</u> | <u>0.00</u> |

| | | | | |
|----------------------------------|--|--------------|--------------|--------------|
| TOTAL CASH IN BANK - POOLED CASH | | 3,114,482.85 | (40,474.12) | 3,074,008.73 |
|----------------------------------|--|--------------|--------------|--------------|

DUE TO OTHER FUNDS - POOLED CASH

| | | | | |
|----------|--------------------|---------------------|---------------------|---------------------|
| 999-2100 | DUE TO OTHER FUNDS | <u>3,114,482.85</u> | <u>(40,474.12)</u> | <u>3,074,008.73</u> |
|----------|--------------------|---------------------|---------------------|---------------------|

| | | | | |
|--------------------------|--|--------------|--------------|--------------|
| TOTAL DUE TO OTHER FUNDS | | 3,114,482.85 | (40,474.12) | 3,074,008.73 |
|--------------------------|--|--------------|--------------|--------------|

CITY of RIVERSIDE FUND BALANCES 12-31-2020

| FUND | NAME | BALANCE 12-31-20 | RESERVES | AVAILABLE FY 21 |
|------------------------------------|---------------|----------------------|-------------------|------------------------------|
| 001 | GENERAL | \$ 581,470.98 | \$ (145,306.62) | \$ 436,164.36 |
| 002 | WATER | \$ 173,750.94 | \$ (89,867.84) | \$ 83,883.10 |
| 110 | R.USE | \$ 166,827.71 | \$ - | \$ 166,827.71 |
| 121 | LOST | \$ 199,866.70 | \$ - | \$ 199,866.70 |
| 145 | CASINO | \$ 182,661.89 | \$ - | \$ 182,661.89 |
| 200 | DEBT | \$ (4,600.00) | \$ - | \$ (4,350.00) |
| 301 | CAP PRO | \$ (68,078.46) | \$ (200,000.00) | \$ (268,078.46) |
| 302 | CB FUNDS | \$ 1,019,904.51 | \$ (1,019,797.95) | \$ - |
| 600 | WATER | \$ 494,519.71 | \$ (73,383.30) | \$ 421,136.41 |
| 610 | SEWER | \$ 303,884.25 | \$ (66,837.84) | \$ 237,046.41 |
| 670 | GARBAGE | \$ 9,711.77 | \$ - | \$ 9,711.77 |
| 680 | STORM | \$ 14,088.73 | \$ - | \$ 14,088.73 |
| | TOTAL | \$ 3,074,008.73 | \$ (1,595,188.55) | \$ 1,478,820.18 |
| POOLED CASH BALANCE 9/30/20 | | | | |
| COMM. BUILDING SET A SIDE | | INTEREST RATE | | MATURITY |
| CD | 18975 | \$ 292,742.74 | 2.60% | 2/5/2022 |
| CD | 19068 | \$ 225,205.60 | 2.60% | 8/30/2022 |
| SAV | 67928 | \$ 501,956.17 | 0.25% | |
| TOTAL | 302 FUND | \$ 1,019,904.51 | | |
| 002 | 29089 | \$ 258,972.40 | 2.82% | 2/25/2021 WATER @ HILLS BANK |
| CHECK | 35308 | \$ 609,417.42 | 0.15% | |
| MM | 67545 | \$ 1,126,094.42 | 0.25% | |
| HILLS | 2656940 | \$ 59,619.98 | 0.24% | WATER ACH BALANCE |
| | TOTAL | \$ 3,074,008.73 | | |
| | LESS RESERVES | \$ (1,595,188.55) | | |
| | LIQUID CASH | \$ 1,478,820.18 | 12/31/2020 | |

12/31/2020

| | | | | |
|-------------------------|--|-----------------|--------------------|--|
| | | \$ 3,074,008.73 | | |
| Cash on Hand | | | | |
| Peoples Checking | | \$ 609,417.42 | | |
| Peoples MM | | \$ 1,126,094.42 | | |
| Hills Bank | | \$ 59,619.98 | (water/sewer/Garb) | |
| | | | \$ 1,795,131.82 | |
| | | | | |
| CD's and Savings | | CD's | Savings | |
| CC CD's | | \$ 292,742.74 | | |
| CC CD's | | \$ 225,205.60 | | |
| Water CD | | \$ 258,972.40 | | |
| | | | | |
| CC Savings | | | \$ 501,956.17 | |
| | | \$ 776,920.74 | \$ 501,956.17 | |

\$ 3,074,008.73

| | | Cash | CD's | Savings Account | Reserves | |
|------------------|--|------------------------|----------------------|------------------------|----------------------|-------|
| | | \$ 1,795,131.82 | | | | |
| | | | | | | |
| General | | \$ 436,164.36 | | | \$ 145,306.62 | **** |
| Fire | | \$ 83,888.10 | | | \$ 89,862.84 | *** |
| RUT | | \$ 166,827.71 | | | | |
| LOST | | \$ 199,866.70 | | | | |
| TIF | | | | | | |
| Casino Rev | | \$ 182,661.89 | | | | ***** |
| Debt Svc | | \$ (4,600.00) | | | | |
| Capital Projects | | \$ (68,078.46) | | | | |
| CC Funds | | | \$ 517,948.34 | \$ 501,956.17 | | |
| Water | | \$ 162,170.62 | \$ 258,972.40 | | \$ 73,383.30 | * |
| Sewer | | \$ 157,039.80 | | | \$ 146,837.84 | ** |
| Garbage | | \$ 9,711.77 | | | | |
| Storm Water | | \$ 14,088.73 | | | | |
| | | | | | | |
| Total | | \$ 1,339,741.22 | \$ 776,920.74 | \$ 501,956.17 | \$ 455,390.60 | |

Treasurer's Report \$ 3,074,008.73

(All cash, CD's,
Savings, Reserves)

* Water-\$73,383.30 Reserves

**Sewer-Engie \$35,000, \$45,000 Lift Station #1, \$66,837.84 Reserves

***FD unspent funds previous years

****3 months reserves

*****transfer from casino to capital projects to fund 200,000 lot sales



COVID-19 vaccine Q&A

Has Public Health received the vaccine?

- Yes – the first shipment arrived on 12/22/20

Has Public Health started vaccinating people?

- Yes – we have started vaccinating those individuals in the 1A priority group.

Is Public Health vaccinating the long-term care residents?

- No – those residents and workers are being vaccinated through Pharmacy agreements and not by Public Health.

When can I be vaccinated?

- The recommendations are set by the Federal government based on availability of vaccine and clinical trial outcomes
- WCPH does not have control over priority groups
- Phase 1A will include long-term care residents, long-term care workers and healthcare workers with direct patient care
 - WCPH will have direct contact with local providers to schedule vaccinations

When will new priority groups be established?

- As more vaccine becomes available, the priority groups will be opened up by the State
- The recommendations are set by the Federal government based on availability of vaccine and clinical trial outcomes
- WCPH does not have control over priority groups

Will there be additional phases of vaccine rollout?

- Yes
 - Phase 1B is anticipated to include frontline workers (fire, law enforcement, day care providers, schools) and populations of individuals that are 75 years of age and older
 - Phase 1C is anticipated to include additional essential workers, individuals aged 65-74 and those aged 18-74 with high risk medical conditions
- Priority group criteria is established by the Federal government and may change
- WCPH does not have control over priority groups

I do not fall into any of the priority groups. When can I be vaccinated?

- By mid-2021 there should be enough vaccine available for anyone who wants it
- WCPH does not have control over priority groups

I have had COVID. Am I eligible for the vaccine?

- Yes IF you meet the criteria below:
 - You fall into a specified priority group AND

- You are not actively ill (meaning in quarantine, isolation, or showing signs of symptoms)

I have had COVID. Do I need to wait for 90 days to receive the vaccine?

- No – HOWEVER you will need to meet criteria for a specified priority group and check with your physician

Is Public Health the only provider of vaccine in the County?

- Yes, at this time

Do you have a waiting list for the vaccine?

- No
 - As new priority groups become effective, WCPH will communicate who meets the criteria

Where is the most up to date information on the vaccine?

- Direct them to our website (washph.com)
 - There are links to IDPH, the CDC, and our FB page
- State of Iowa dashboard
 - <https://coronavirus.iowa.gov>
- WCPH Facebook page
- The Washington Journal

When will our children be vaccinated?

- At this time, Pfizer is approved for individuals 16 years of age and older. Moderna is approved for those 18 years of age. At this time, we don't know when a vaccine will be approved for children.

After I get vaccinated, will I still have to wear a mask/be quarantined after COVID exposure?

- At this time, there will be no change to our current public health recommendations for those who have been vaccinated. We'd still recommend you wear a mask around those not in your household, social distance, and quarantine post-exposure.

If someone has further questions, direct them to Danielle or Karri

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart=20201201:dateend=20201231:Zone=CRIV

| <u>Date/Time</u> | <u>CFS</u> | <u>Call Type</u> | <u>Zone</u> |
|---|------------|-----------------------------|-------------|
| 12/01/2020 22:06:10 | 2011843 | TRAFFIC STOP SERIOUS | CRIV |
| <u>Agency:</u> Washington County Sheriff's Office | | | |
| <u>Address:</u> 3070 HWY 22 | | | |
| <u>City/State/Zip:</u> RIVERSIDE, IA 52327 | | | |
| <u>details:</u> | | | |
| [12/01/2020 22:06:52] | | | |
| VEHICLE STOP WITH WHITE CHRYSLER 300 NO PLATES. 92-9 CITED NAM/COLEMAN,MARIO DEANDRE AGE/30 ADR/814 BENTON DR APT 33 IOWA CITY,IA OFFENSE/DRIVING UNDER SUSPENSION X1 AND OPERATING A NON REGISTERED VEHICLE | | | |
| 12/02/2020 19:17:08 | 2011871 | WARRANT ARREST | CRIV |
| <u>Agency:</u> Washington County Sheriff's Office | | | |
| <u>Address:</u> 3184 HWY 22 | | | |
| <u>City/State/Zip:</u> RIVERSIDE, IA 52327 | | | |
| <u>details:</u> | | | |
| [12/02/2020 19:18:46] | | | |
| DEPUTY REPORTS TRANSPORTING A SUBJECT TO THE JAIL ON A US MARSHALLS SERVICE WARRANT. ARRESTED NAM/NAM/TURNER,BRADLEY EUGENE AGE/50 ADR/605 MAIN ST. DAVENPORT,IA OFFENSE/US MARSHALLS SERVICE WARRANT FOR PROBATION VIOLATION NO BOND | | | |
| 12/02/2020 21:20:00 | 2011875 | TRESPASS | CRIV |
| <u>Agency:</u> Washington County Sheriff's Office | | | |
| <u>Address:</u> 3184 HWY 22 | | | |
| <u>City/State/Zip:</u> RIVERSIDE, IA 52327 | | | |
| <u>details:</u> | | | |
| [12/02/2020 21:21:53] | | | |
| CALLER REQUESTS ASSISTANCE WITH TWO GUESTS WHO ARE REFUSING TO LEAVE AFTER HARASSING STAFF. THEY ARE OUTSIDE IN ROW 8A NEXT TO A BLACK MERCEDES SUV. 92-14 RESPONDED. THEY LEFT PRIOR TO DEPUTY ARRIVAL. | | | |
| 12/04/2020 09:52:07 | 2011928 | INTIMIDATION/HARAS SMENT | CRIV |
| <u>Agency:</u> Washington County Sheriff's Office | | | |
| <u>Address:</u> 661 E HICKORY ST | | | |
| <u>City/State/Zip:</u> RIVERSIDE, IA 52327 | | | |

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

details:

[12/04/2020 10:02:44]

CALLER REPORTS HARASSMENT VIA SOCIAL MEDIA. 92-8 RESPONDED. DOCUMENTATION.

12/04/2020 11:15:49 2011929 ALL OTHER THEFT CRIV

Agency: Washington County Sheriff's Office

Address: 3184 HWY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/04/2020 11:19:50]

REPORTS THE LICENSE PLATES WERE TAKEN OFF OF A VEHICLE SOMETIME SINCE WEDNESDAY. PARKED IN SECTION 9A. DJAMEL LALLOUT. SURVEILLANCE IS BEING REVIEWED.

92-8 RESPONDED. NO SUSPECTS. LIC/JCL272 ENTERED INTO THE SYSTEM. SIN/3088290. DOCUMENTATION.

12/04/2020 16:33:04 2011942 SHOPLIFTING CRIV

Agency: Washington County Sheriff's Office

Address: 3021 HWY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/04/2020 16:33:47]

CALLER REPORTS A THEFT THAT OCCURRED LAST NIGHT AND THEY HAVE IT ON VIDEO.

92-14 RESPONDED. REPORT TO BE FILED.

12/04/2020 19:34:34 2011948 FIRE CALLS CRIV

Agency: Fire

Address: 1092 WALNUT AVE

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/04/2020 19:36:15]

CALLER REPORTS A SPRINKLER SYSTEM MALFUNCTION 3RD BLDG UNIT 222 AND THEY NEED THE FIRE DEPARTMENT.

RIVERSIDE FIRE DEPARTMENT RESPONDED AND ASSISTED.

12/05/2020 16:46:29 2011987 TRAFFIC OTHER CRIV

Agency: Washington County Sheriff's Office

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

Address: 211 SCHNOEBELEN ST

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/05/2020 16:47:50]

CALLER REPORT TWO HORSE TRAILERS PARKED ON THE STREET THAT COULD CAUSE A PROBLEM IF A FIRE TRUCK WOULD HAVE TO GET THROUGH. 92-10 RESPONDED AND SPOKE WITH SOMEONE WHO WILL GET THE TRAILERS MOVED.

12/08/2020 15:09:30 2012090 STOLEN PROPERTY CRIV

Agency: Washington County Sheriff's Office

Address: 3021 HWY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/08/2020 15:24:31]

CALLER REPORTS A CAR BURGLARY. 92-8 RESPONDED AND ALSO REPORTED A SHOPLIFTING INCIDENT.

AFTER REVIEWING SECURITY FOOTAGE, 92-8 WILL HAVE CHARGES ON NAM/TRUNECEK, NATHAN ROBERT AGE/35 ADR/1331 36TH ST SE CEDAR RAPIDS IOWA OFFENSE/BURGLARY

DEPUTY WILL ALSO HAVE CHARGES ON NAM/MCNAMARA, SIDNEY LEA AGE/35 ADR/425 MAPLE DR WALFORD IOWA OFFENSE/SHOPLIFTING

REPORT TO BE FILED.

12/09/2020 19:57:32 2012130 SUSPICIOUS CRIV
ACTIVITY

Agency: Washington County Sheriff's Office

Address: 1178 ENTERPRISE DR

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/09/2020 19:59:23]

CALLER REPORTING A SUSPICIOUS ITEM WAS TURNED INTO THEM.

92-54 RESPONDED AND SEIZED THE ITEM. DOCUMENTATION.

12/11/2020 01:45:25 2012192 TRAFFIC-ACCIDENT CRIV

Agency: Washington County Sheriff's Office

Address: 1178 ENTERPRISE DR

City/State/Zip: RIVERSIDE, IA 52327

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

details:

[12/11/2020 01:47:25]

CALLER REPORTS A VEHICLE IS PARKED UP AGAINST THE REAR SIDE OF THE BUILDING WITH HAZARD LIGHTS AND WINSHIELD WIPERS ON. 92-7 AND 92-14 RESPONDED AND REQUESTED MEDICAL. AD57 RESPONDED AND TRANSPORTED THE SUBJECT TO THE UNIVERSITY OF IOWA HOSPITAL IN IOWA CITY ARRIVING AT 0241. INCIDENT TOOK PLACE ON PRIVATE PROPERTY. DOCUMENTATION. VEHICLE WAS TOWED BY MOORES.

12/11/2020 09:32:11 2012200 ASSAULT-DOMESTIC CRIV

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/11/2020 10:26:45]

[12/11/2020 09:33:46]

REPORTS A DOMESTIC SITUATION IN ROW 8A, FEMALE BEING DRUG BY A WHITE SEDAN. REQUEST ASSISTANCE. SPOKE WITH BOTH PARTIES. FEMALE REFUSED TO PURSUE CHARGES. BOTH SUBJECTS HAVE BEEN BANNED FROM THE CASINO PROPERTY FOR THE DAY.

12/11/2020 11:59:39 2012207 TRAFFIC-DEBRIS CRIV

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/11/2020 12:02:09]

REPORTS THERE IS DEBRIS IN THE ROAD ON HWY 22, NEAR THE CASINO.

92-10 AND STATE ROADS RESPONDED. DEBRIS WAS REMOVED FROM THE ROADWAY.

12/12/2020 00:03:33 2012235 TRAFFIC CRIV

STOP-INTOXICATED DRIVER

Agency: Washington County Sheriff's Office

Address: E 1ST ST&S PIONEER ST

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/12/2020 00:05:37]

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

92-9 REPORTS A TRAFFIC STOP. 92-9 REPORTED TASING A SUBJECT. 92-14 RESPONDED AND 92-9 ARRESTED NAM/HALL, WILLIAM GERALD AGE/32 ADDRESS/E 1ST ST APT 51 1/2 RIVERSIDE IOWA OFFENSE/OWI FIRST OFFENSE, INTERFERENCE WITH OFFICIAL ACT ASSAULT ON PERSON IN CERTAIN OCCUPATION AND POSSESSION OF CONTROLLED SUBSTANCE MARIJUANA.

SUBJECT IS ALSO WANTED OUT OF JOHNSON COUNTY FOR VIOLATION OF NO CONTACT ORDER, NO BOND. JOHNSON COUNTY WILL EXTRADITE. LOCATE PLACED ON SUBJECT.

12/12/2020 09:04:49 2012247 ANIMAL-BITE CRIV

Agency: Washington County Sheriff's Office

Address: 3056 RIVER CROSSING CT

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/12/2020 09:10:02]

CALLER REPORTS A SUBJECT SOMEHOW GOT INTO THE LOBBY OF THE CLINIC EVEN THOUGH IT WAS CLOSED. THE SUBJECT WAS IRRATE WAS YELLING IN THE LOBBY. 92-17 RESPONDED AND THE WIFE OF THE SUBJECT CALLED IN STATING THAT HER HUSBAND WAS BIT IN THE FACE BY A DOG. THEY LEFT THE SCENE PRIOR TO OFFICER ARRIVAL. REPORT TO BE FILED.

****12/14/20 DOG WASNT UP TO DATE ON SHOTS AND TURNED OVER TO WASHINGTON COUNTY ENVIRONMENTAL ****

12/12/2020 22:22:55 2012268 TRAFFIC CRIV
STOP-INTOXICATED
DRIVER

Agency: Washington County Sheriff's Office

Address: 0000 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/12/2020 22:23:21]

DEPUTY REPORTS A VEHICLE STOP WITH LIC/GBM806 ON THE NORTH BOUND ON RAMP TO HIGHWAY 218 FROM HIGHWAY 22. 92-9 ADVISES CHARGES PENDING DCI LAB RESULTS FOR OWI 1ST OFFENSE. REPORT FILED.

12/12/2020 23:06:12 2012270 PUBLIC CRIV
INTOXICATION

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/12/2020 23:13:10]

REPORTS BEING OUT AT THE CASINO WITH A POSSIBLE INTOXICATED SUBJECT. 92-14 ARRESTED NAM/PASTRANA, JOSE IRINEO (32) ADR/UNKNOWN'S OFFENSE/PUBLIC INTOXICATION 1ST.

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

12/12/2020 23:48:50 2012271 PUBLIC CRIV
INTOXICATION

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/12/2020 23:51:29]

CASINO REPORTS 2 SUBJECTS WALKING SOUTH TOWARDS THE HIGHWAY THAT ARE POSSIBLY INTOXICATED. BOTH WEARING BLUE JEANS AND GRAY JACKETS, ONE WEARING A BLACK/YELLOW STOCKING CAP THE OTHER WEARING A BALL CAP. 92-7 RESPONDED, SUBJECTS WERE AT THE ENTRANCE OF THE CASINO WAITING ON A RIDE, DEPUTY STOOD BY UNTIL UBER ARRIVED.

12/13/2020 00:23:13 2012272 TRAFFIC-DISABLED CRIV
VEHICLES

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/13/2020 00:23:42]

92-7 REPORTS BEING FLAGGED DOWN BY SUBJECTS HAVING VEHICLE TROUBLES. EVERYTHING WAS FINE.

12/13/2020 00:57:45 2012274 DRUG/NARCOTICS CRIV
VIOLATION

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/13/2020 00:59:15]

DEPUTY REPORTS AN ARREST FROM AN EARLIER TRAFFIC STOP. 92-9 ARRESTED NAM/MOYE, JERMAINE HERBERT (31) ADR/2912 BREYER ST SW, CEDAR RAPIDS OFFENSE/POSSESSION OF CONTROLLED SUBSTANCE 1ST OFFENSE. SUBJECT TRANSPORTED TO WASHINGTON COUNTY JAIL.

12/13/2020 01:03:07 2012275 ALL OTHER CRIV
OFFENSES

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/13/2020 01:05:31]

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

CALLER REPORTS A LARGE GROUP OF PEOPLE WERE KICKED OUT OF THE HOTEL AND ARE NOW UPSET AND NOT COOPERATING. ANOTHER CALLER REQUESTS TO SPEAK TO AN OFFICER. PARTIES SEPERATED FOR THE NIGHT. SUBJECTS LEFT THE CASINO.

12/13/2020 03:17:59 2012276 FAMILY OFFENSE CRIV
NON-VIOLENT

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

CityStateZip: RIVERSIDE, IA 52327

details:

[12/13/2020 03:20:42]

CALLER REPORTS A SUBJECT CAME TO THE FRONT DESK AND INFORMED THEM THAT THEY HAVE BEEN ASSAULTED BY THEIR HUSBAND. SUBJECT REPORTS THEIR HUSBAND IS STILL IN THE HOTEL ROOM. CALLER ADVISED MEDICAL IS NOT NEEDED. 92-9 RESPONDED AND REPORTED IT WAS A VERBAL ARGUMENT ONLY AND THE PARTIES SEPARATED FOR THE NIGHT.

12/13/2020 09:07:29 2012280 TRESPASS CRIV

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

CityStateZip: RIVERSIDE, IA 52327

details:

[12/13/2020 09:08:51]

REPORTS A SUBJECT WHO WAS KICKED OUT LAST NIGHT APPEARS TO BE IN A HOTEL ROOM WITH THE DEADBOLT LOCKED. REQUESTING CRIMINAL TRESPASS CHARGES BE FILED.

92-8 RESPONDED. SUBJECTS WERE GONE PRIOR TO ARRIVAL.

12/17/2020 09:42:12 2012426 CIVIL STANDBY CRIV

Agency: Washington County Sheriff's Office

Address: 71 W 3RD ST

CityStateZip: RIVERSIDE, IA 52327

details:

[12/17/2020 09:46:11]

REQUESTS ASSISTANCE WHEN SERVING EVICTIONS PAPERS ON A SUBJECT AS THERE WILL BE PROBLEMS.

CALLER LATER ADVISED THE SUBJECT HAD LEFT THE RESIDENCE AND DOES NOT NEED OUR ASSISTANCE AT THIS TIME.

12/19/2020 09:11:43 2012534 ALL OTHER CRIV
OFFENSES

Agency: Washington County Sheriff's Office

Address: 3078 HIGHWAY 22

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/19/2020 09:18:09]

CALLER REPORTS THE DOOR CAME DOWN ONTO HIS VEHICLE BETWEEN THE CAB AND THE BACK END. CALLER WAS ABLE TO GET THE DOOR UP WITH BUTTON INSIDE THE CARWASH AREA. 92-10 RESPONDED. INFORMATION EXCHANGED.

12/20/2020 18:32:26 2012604 TRAFFIC-DISABLED CRIV
VEHICLES

Agency: Washington County Sheriff's Office

Address: 1092 WALNUT AVE

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/20/2020 18:33:49]

OUT WITH A POTENTIAL DISABLED VEHICLE. 92-14 ADVISED IT WAS NOT A DISABLED VEHICLE. THEY HAD TURNED THEIR HAZARDS ON TO TALK ON THE PHONE.

12/20/2020 18:51:37 2012606 ASSIST OTHER CRIV
AGENCY

Agency: Washington County Sheriff's Office

Address: 140 E 3RD ST

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/20/2020 18:52:37]

CALLER REQUESTS ASSISTANCE IN LOCATING A VEHICLE INVOLVED IN A HIT AND RUN IN IOWA CITY. 92-14 RESPONDED TO ASSIST JOHNSON COUNTY.

12/20/2020 22:42:11 2012616 INTIMIDATION/HARAS CRIV
SMENT

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[01/01/2021 12:05:03]

Linked to CFS#: 2100017

[12/20/2020 22:46:22]

CALLER REPORTS RECEIVING SEVERAL THREATS FROM A SUBJECT WHO WAS KICKED OUT OF THE BUSINESS. 92-7, 92-9, AND 92-14 ALL RESPONDED BUT WERE UNABLE TO LOCATE. DEPUTY WILL STAY IN THE AREA.

[12/31/2020 05:00:00]

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

12/21/2020 13:13:33 2012638 92-7 WILL HAVE CHARGES ON THE SUBJECT FOR HARRASMENT 1ST, TRESPASSING, AND IMPERSONATING A PEACE OFFICER.

INTIMIDATION/HARAS CRIV
SMENT

Agency: Washington County Sheriff's Office

Address: 91 N GREENE ST

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/21/2020 13:24:56]

CALLER REPORTS THEY HAVE RECEIVED A SCAM TEXT AND IS CONCERNED. 92-10 RESPONDED. DOCUMENTATION.

12/23/2020 07:41:08 2012724 TRESPASS CRIV

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/23/2020 07:43:25]

CALLER REQUEST A DEPUTY AT THE RIVERSIDE CASINO TO REMOVE A SUBJECT WHO IS BANNED FROM THE PROPERTY. THEY REPORT THAT HE MIGHT BE IN A HOTEL ROOM. 92-8 AND 92-6 RESPONDED. THE SUBJECT HAD LEFT PRIOR TO DEPUTY ARRIVAL.

12/23/2020 10:35:06 2012732 THEFT-OTHER CRIV

Agency: Washington County Sheriff's Office

Address: 260 W 1ST ST

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/23/2020 10:39:14]

REPORTS A DEALER PLATES MISSING FROM A VEHICLE.

92-8 WAS ADVISED. PLATE ENTERED AS STOLEN. SIN/3093036.

12/25/2020 10:32:36 2012801 TRAFFIC CRIV

STOP-INTOXICATED
DRIVER

Agency: Washington County Sheriff's Office

Address: 1178 ENTERPRISE DR

City/State/Zip: RIVERSIDE, IA 52327

details:

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

[12/25/2020 10:34:15]

REPORTS THERE IS A BLACK IMPALA TYPE CAR, WITH TAMA COUNTY PLATES, THAT HAS A FEMALE WHO APPEARS TO BE INTOXICATED IN IT. HER MALE PASSENGER IS BLOWING IN THE IGNITION INTERLOCK DEVICE, TO GET THE VEHICLE STARTED AND ITS NOT WORKING. REQUEST A DEPUTY.

VEHICLE LOCATED AT CASEYS EAST. SPOKE WITH DRIVER AND PASSENGER. NEITHER WERE INTOXICATED.

12/25/2020 19:15:34 2012810 WELFARE CHECK CRIV

Agency: Washington County Sheriff's Office

Address: 3021 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/25/2020 19:16:53]

TWO CALLERS REPORTS A MALE IN A GRAY SWEATSHIRT AND SWEATPANTS IS WALKING ON THE SHOULDER OF THE HIGHWAY. ONE CALLER ADVISED HIGHWAY 218 SOUTHBOUND AT EXIT 80. THE 2ND CALLER ADVISED THEY WERE NOW WESTBOUND ON HIGHWAY 22 NEAR THE DOLLAR GENERAL. 92-15 RESPONDED AND WAS UNABLE TO LOCATE THE SUBJECT IN THE AREA.

12/26/2020 22:13:11 2012842 DISORDERLY CONDUCT CRIV

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/26/2020 22:16:16]

CALLER REPORTS AN INTOXICATED GUEST WAS EJECTED FROM THE GAMING FLOOR AND IS NOW REFUSING TO TAKE A TAXI. 92-7, 92-15 AND 92-20 RESPONDED. THE CASINO ADVISED THE SUBJECT HAD GOTTEN INTO A VEHICLE AS A PASSENGER PRIOR TO DEPUTY ARRIVAL.

12/27/2020 01:47:41 2012848 TRESPASS CRIV

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/27/2020 01:51:10]

CALLER REPORTS THERE IS POSSIBLY A SUBJECT WHO IS BANNED FROM THE BUSINESS ON THE PROPERTY. 92-7, 92-15 AND 92-20 RESPONDED. THE CALLER LATER REPORTED IT WAS NOT WHO THEY THOUGHT IT WAS AND DISREGARDED ALL RESPONDING UNITS PRIOR TO ARRIVAL.

12/27/2020 07:58:43 2012853 TRAFFIC-DISABLED VEHICLES CRIV

Date Printed: 1/5/2021 10:19 AM

Page: 10 of 12

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

Agency: Washington County Sheriff's Office

Address: 51 SAINT MARYS ST

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/27/2020 08:06:53]
REPORTS BEING OUT WITH VEHICLE LIC/JYU240, PARKED IN THE ST MARYS PARKING LOT, RIVERSIDE. VEHICLE HAS DAMAGE TO THE DRIVERS SIDE AND LONG GRASS HANGING UNDERNEATH LIKE IT WAS DRIVEN THROUGH A FIELD.

DOCUMENTATION IN CASE ANYONE CALLS IN WITH DAMAGE.

12/27/2020 15:39:00 2012866 TRAFFIC CRIV
STOP-INTOXICATED DRIVER

Agency: Washington County Sheriff's Office

Address: 691 E HICKORY ST

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/27/2020 15:55:01]
DEPUTY REPORTS RECEIVING LAB RESULTS. 92-10 CITED NAM/LATTA, JAMES CLIFFORD AGE/58 ADR/691 E HICKORY ST. RIVERSIDE, IA OFFENSE/OPERATING WHILE INTOXICATED 1ST OFFENSE

12/28/2020 20:23:42 2012931 SEX CRIV
OFFENDER-CHECK

Agency: Washington County Sheriff's Office

Address: 41 N GREENE ST

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/28/2020 20:24:11]
S.O.R CHECK. PRESENT. CRIV
12/28/2020 22:57:28 2012938 ASSIST OTHER AGENCY

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/28/2020 22:59:27]
REQUEST ASSISTANCE LOCATING A SUBJECT WHO MAY BE IN WASHINGTON COUNTY. DEPUTIES RESPONDED, UNABLE TO LOCATE.

WASHINGTON COUNTY SHERIFF'S OFFICE

Town Report

Filter: datestart-20201201:dateend-20201231:Zone-CRIV

12/30/2020 17:28:58 2013061

FAMILY OFFENSE CRIV
NON-VIOLENT

Agency: Washington County Sheriff's Office

Address: 1178 ENTERPRISE DR

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/30/2020 17:33:05]

CALLER REPORTS HER SOON TO BE EX WHOM SHE HAS A NO CONTACT ORDER WITH JUST TRIED APPROACHING HER WHILE SHE WAS CLEANING OFF HER VEHICLE. HE LEFT NORTH BOUND OUT OF THE PARKING LOT DRIVING A MAROON FORD F250. 92-11 RESPONDED, SPOKE WITH BOTH PARTIES AND WILL FORWARD THE INFORMATION TO THE COUNTY ATTORNEY. DOCUMENTATION ONLY AT THIS TIME.

12/31/2020 07:31:59 2013089

WEATHER RELATED CRIV

Agency: Washington County Sheriff's Office

Address: E 1ST ST&E 2ND ST

City/State/Zip: RIVERSIDE, IA 52327

details:

[12/31/2020 07:33:39]

REPORTS HER VEHICLE IS STUCK IN THE ALLEY BY THE MUSEUM. GOLD CHEVY IMPALA.

12/31/2020 23:59:39 2100001

92-8 RESPONDED AND ASSISTED THE DRIVER.
TRAFFIC CRIV
STOP-INTOXICATED
DRIVER

Agency: Washington County Sheriff's Office

Address: 3184 HIGHWAY 22

City/State/Zip: RIVERSIDE, IA 52327

details:

[01/01/2021 00:01:40]

DEPUTY REPORTS BEING OUT ON A TRAFFIC STOP. 92-10 ALSO RESPONDED.

92-9 ARRESTED NAM/NOONER, MICHAEL AGE/43 ADR/2162 BROOKLAND RD NE CEDAR RAPIDS IOWA OFFENSE/OWI 1ST OFFENSE